DEMOLITION NOTES THIS SHEET

1. REMOVE DUCTWORK, GRILLES AND DIFFUSERS, INSULATION, HANGERS AND SUPPORTS COMPLETE TO POINT INDICATED. PROVIDE TEMPORARY AIRTIGHT CAPS WHERE DUCT WILL BE RECONNECTED.
2. ALL EQUIPMENT AND DUCT IN HATCHED REGION IS EXISTING TO REMAIN.
3. REMOVE CEILING MOUNTED UNIT HEATER, HANGERS AND SUPPORTS.
4. REMOVE CEILING MOUNTED FAN COIL UNIT OR UNIT VENTILATOR, HANGERS, AND SUPPORTS. REMOVE AL ASSOCIATED DUCTWORK, THERMOSTAT AND CONTROL WIRING.
5. REMOVE ROOF HOOD. PROVIDE INSULATED SHEET METAL CAP OVER ROOF CURB. CROSS BREAK TO PREVENT OIL PANNING.

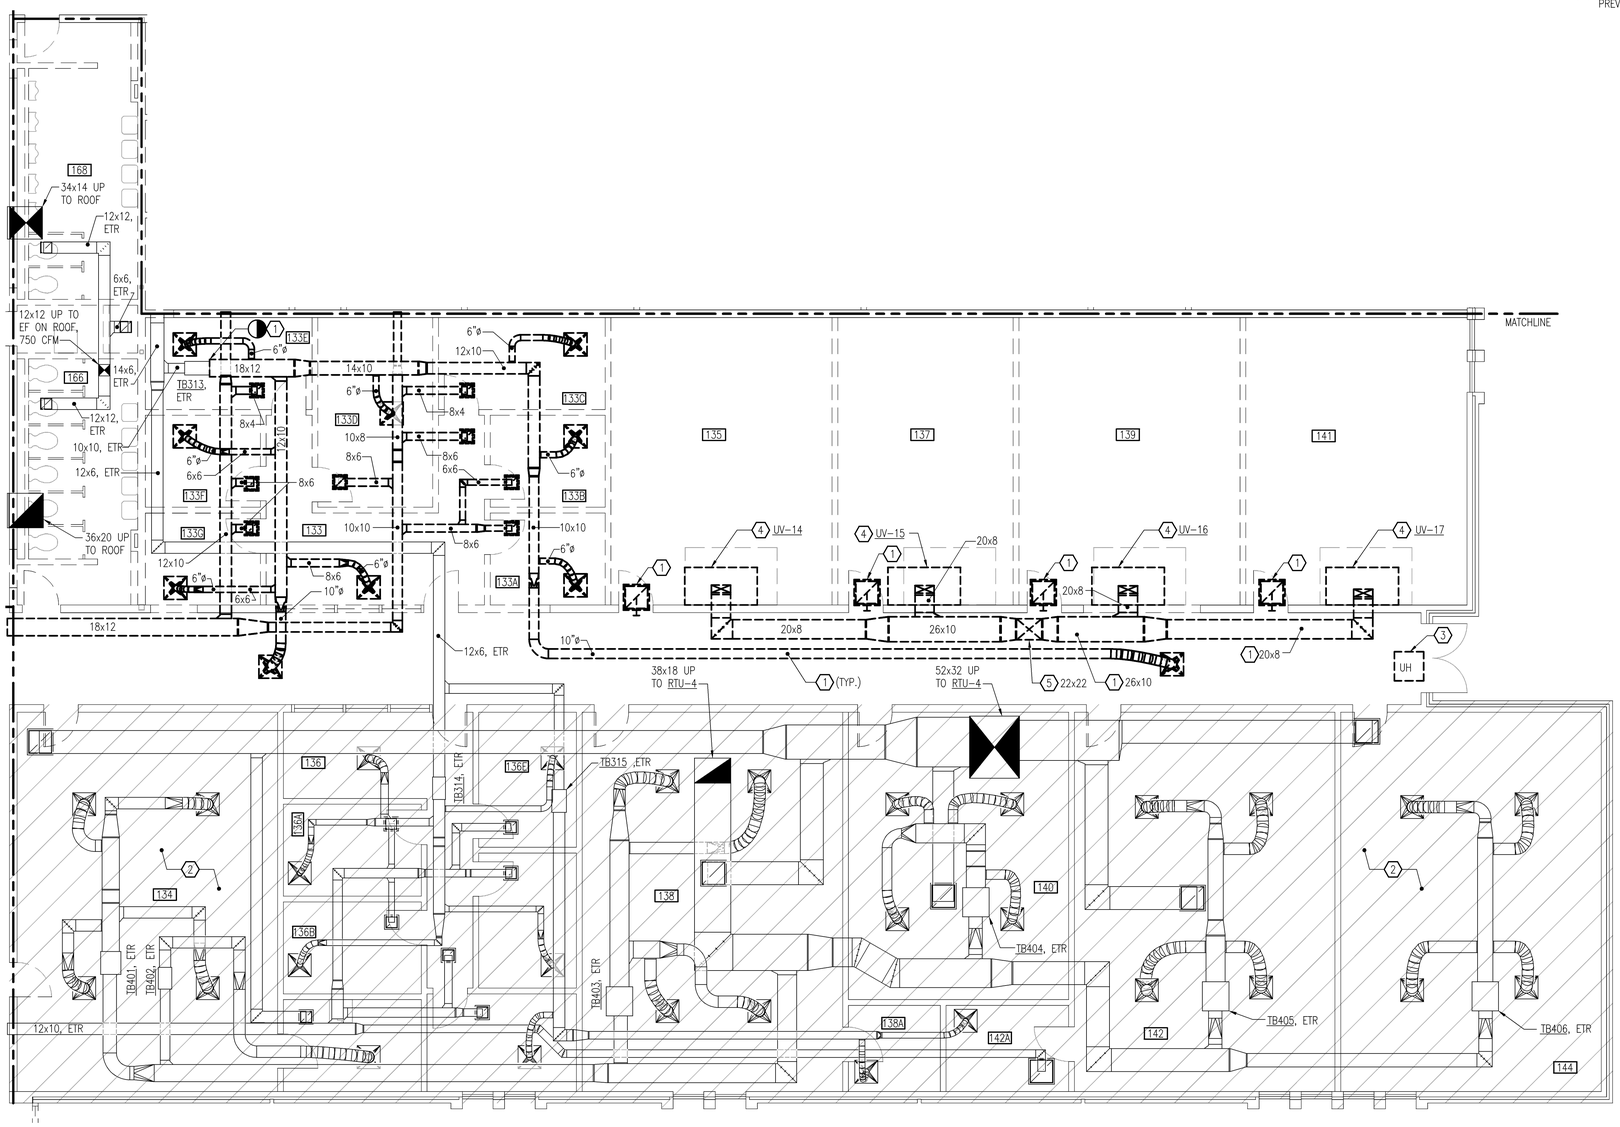

DEMOLITION FLOOR PLAN – MECHANICAL DUCTWORK

SCALE: 3/16" = 1'-0"

ASBESTOS AND LEAD PAINT NOTE

AN ASBESTOS INSPECTION WAS PERFORMED AND ASBESTOS CONTAINING MATERIALS WERE FOUND GENERALLY IN THE AREAS INDICATED IN THE ASBESTOS SURVEY/INSPECTION REPORT WHICH IS AVAILABLE TO THE CONTRACTOR(S) FOR HIS INFORMATION. ASBESTOS CONTAINING MATERIALS HAVE BEEN REMOVED UNDER A SEPARATE CONTRACT.

A LEAD-BASED PAINT INSPECTION WAS PERFORMED AND LEAD-BASED PAINT WAS FOUND IN THE AREAS INDICATED. THE CONTRACTOR SHALL BE RESPONSIBLE WITH ALL REQUIREMENTS OF THE VIRGINIA OCCUPATIONAL SAFETY AND HEALTH ADMINISTRATION REGULATIONS LEAD-BASED PAINT PROTECTION OF WORKERS.



KEYPLAN

NO SCALE

GRAPHIC SCALES

3/16" = 1'-0" 0' 5' 10' 20'

nbj ARCHITECTURE
A Professional Limited Company
GROVE PARK SQUARE
11537-B NUCKOLS ROAD
Richmond, Virginia 23059
(804) 273-9811 fax: (804) 273-9843

RAPPAHANNOCK COMMUNITY COLLEGE
CAMPUS RENOVATIONS
WARSAW + GLENNS, VIRGINIA
PC: 260-17712

GLENNS CAMPUS
DEMOLITION FLOOR
PLAN - MECHANICAL DUCTWORK

Date: JANUARY 13, 2010

REVISIONS

NO.	DATE

Pace COLLABORATIVE
MECHANICAL ELECTRICAL ENGINEERS
VIRGINIA BEACH, VA - 757-486-7223

COMMONWEALTH OF VIRGINIA
JOHN M. NEWELL
Lic. No. 035329
01.13.10
PROFESSIONAL ENGINEER

Sheet
MD1.4G

File Number
XX